No. 930794-T2

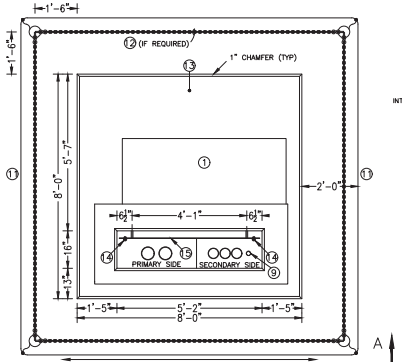

CUSTOMER MUST MAINTAIN THE 9' X 9' AREA IN FRONT OF THE PAD AS A CLEAR, STABLE, LEVEL, UNOBSTRUCTED WORK SPACE

ELECTRICAL EQUIPMENT LAYOUT PLAN
SCALE: 1/2"=1'

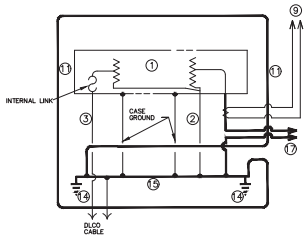

SINGLE LINE DIAGRAM
SCALE: NTS
LIGHT LINES – DLCO WORK
HEAVY LINES – CUSTOMER'S WORK

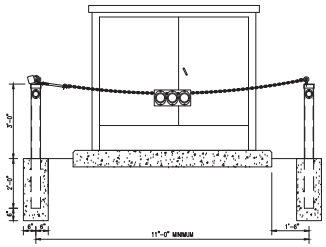

POST AND CHAIN DETAIL
SCALE: 1/2"=1'

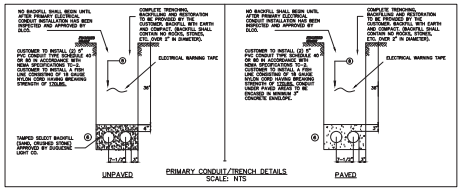

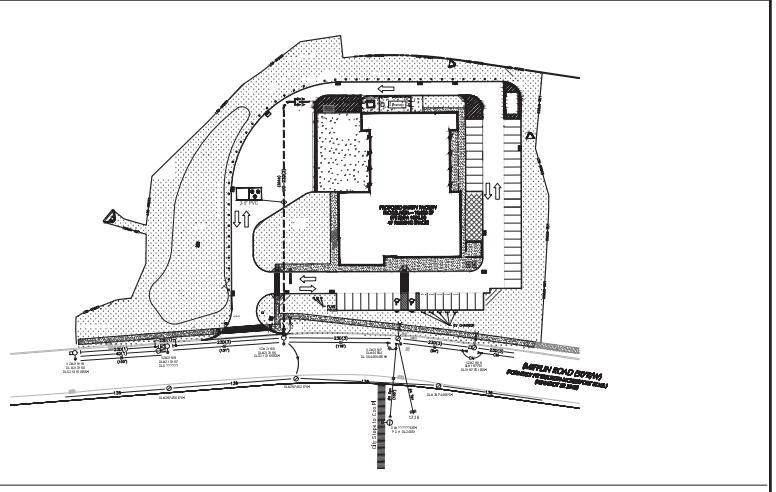
MIFFLIN ROAD EXTENSION
PROPOSED ROADWAY
PROPOSED RIGHT OF WAY
DUQUESNE LIGHT CO. PROPOSED 500 KVA PAD MOUNTED TRANSFORMER
PROPOSED 6' CHAIN LINK FENCE
PROPOSED 6' WIDE GATE
PROPOSED 6' WIDE GATE
PROPOSED 6' CHAIN LINK FENCE
PROPOSED 6' CHAIN LINK FENCE
PROPOSED 6' CHAIN LINK FENC